

General notes:

This drawing to be read in conjunction with all relevant architectural drawings and specifications.


This drawing to be read in conjunction with all relevant structural drawings and specifications.

This drawing to be read in conjunction with all relevant mechanical and electrical drawings and specifications. All dimensions in millimeters, do not scale from this drawing, only use figured dimensions only.



Contractor must verify all dimensions on site prior to installation of services and production of working drawings.

Notes:

1. The electrical installation shall be in accordance with ETCI regulations - Fourth Edition
2. All mini pillar vaults by main contractor, mini pillar vault locations to be fully coordinated onsite to avoid placement in trafficked areas
3. The ducting shall be installed in full compliance with ESB LV & MV requirements
4. There must be a minimum distance of 2 metres between the ESB mini pillar between the first public lighting column of micro pillar
5. Contractor to construct substention kiosk to ESB requirements as indicated.

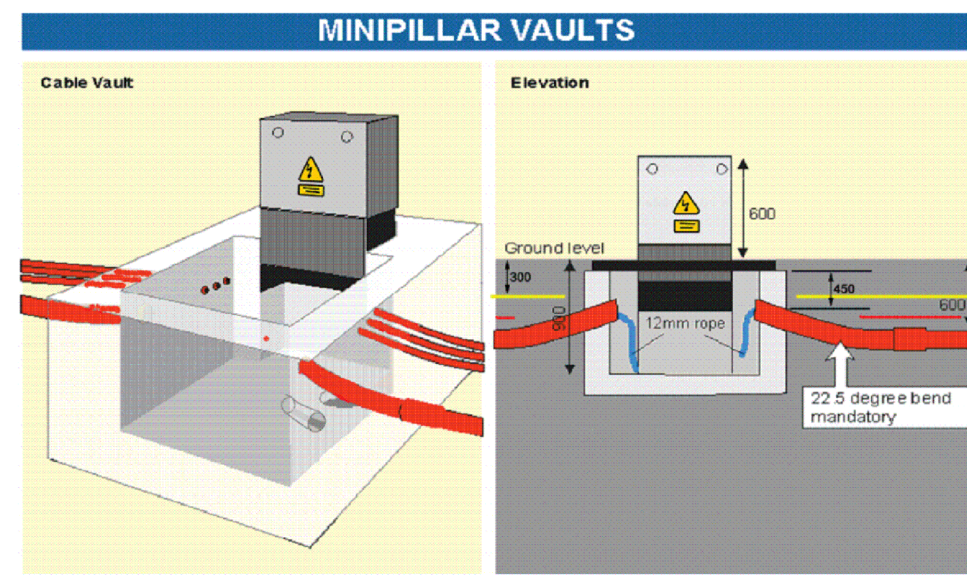

Block built Minipillar vaults are not acceptable

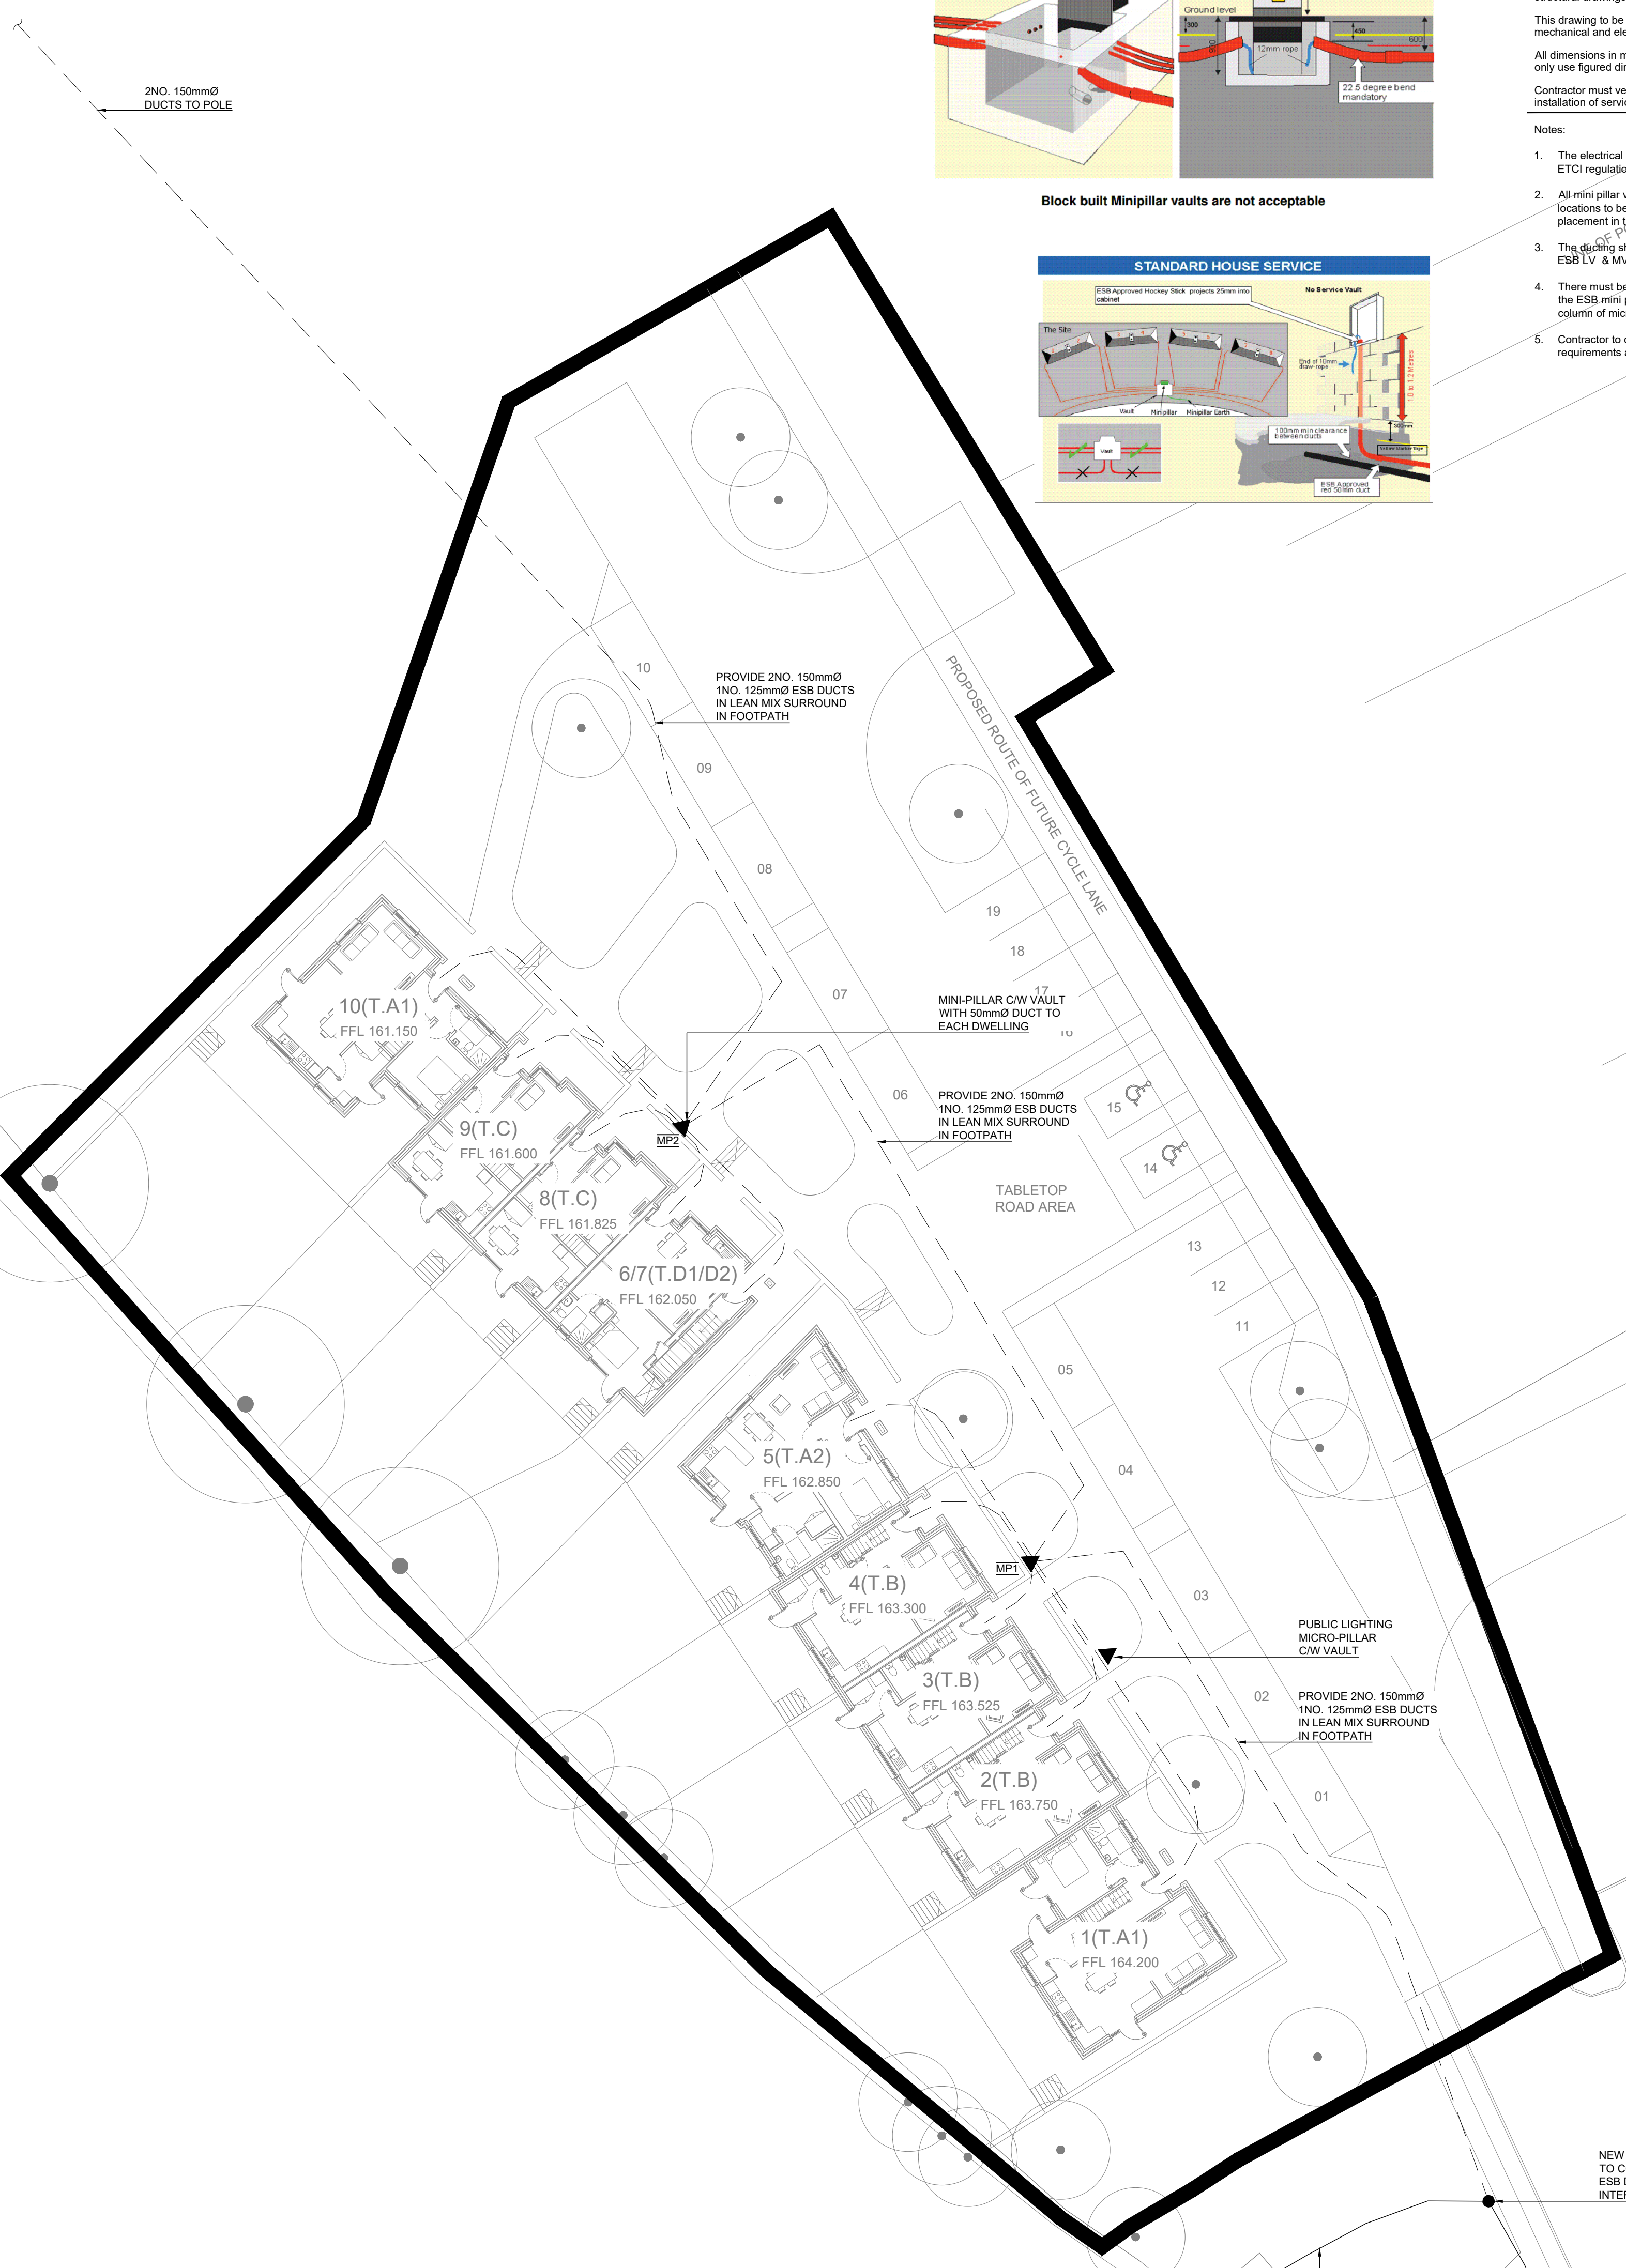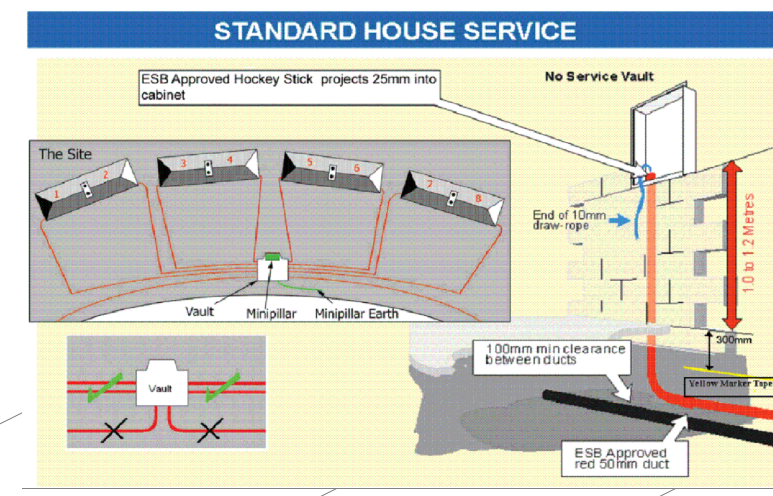

LINE OF POSSIBLE FUTURE FUTURE ROAD

P1	Issued for Planning	15/11/21
Rev	Description	Date



Client: LIMERICK CITY & CO. COUNCIL
MERCHANTS QUAY LIMERICK

Architect: LIMERICK CITY & CO. COUNCIL
HOUSING DEPARTMENT
MERCHANTS QUAY LIMERICK

Project: RADHARC CILLIN
KILFINANE CO. LIMERICK

Drawing: ELECTRICAL INSTALLATION
NEW ESB DUCTING SERVICES
STAGE 2A

Proj Ref | 214.2149 | Drg Ref | ES.02 | Scale | 1:100 A1

Drawn | GJA | Checked | JM | Approved | MF

Drawing Status:
 Preliminary For Approval Tender Issue
 For Information For Comment Contract Issue