




STD-W-01 WATER SERVICE CONNECTION RESPONSIBILITY

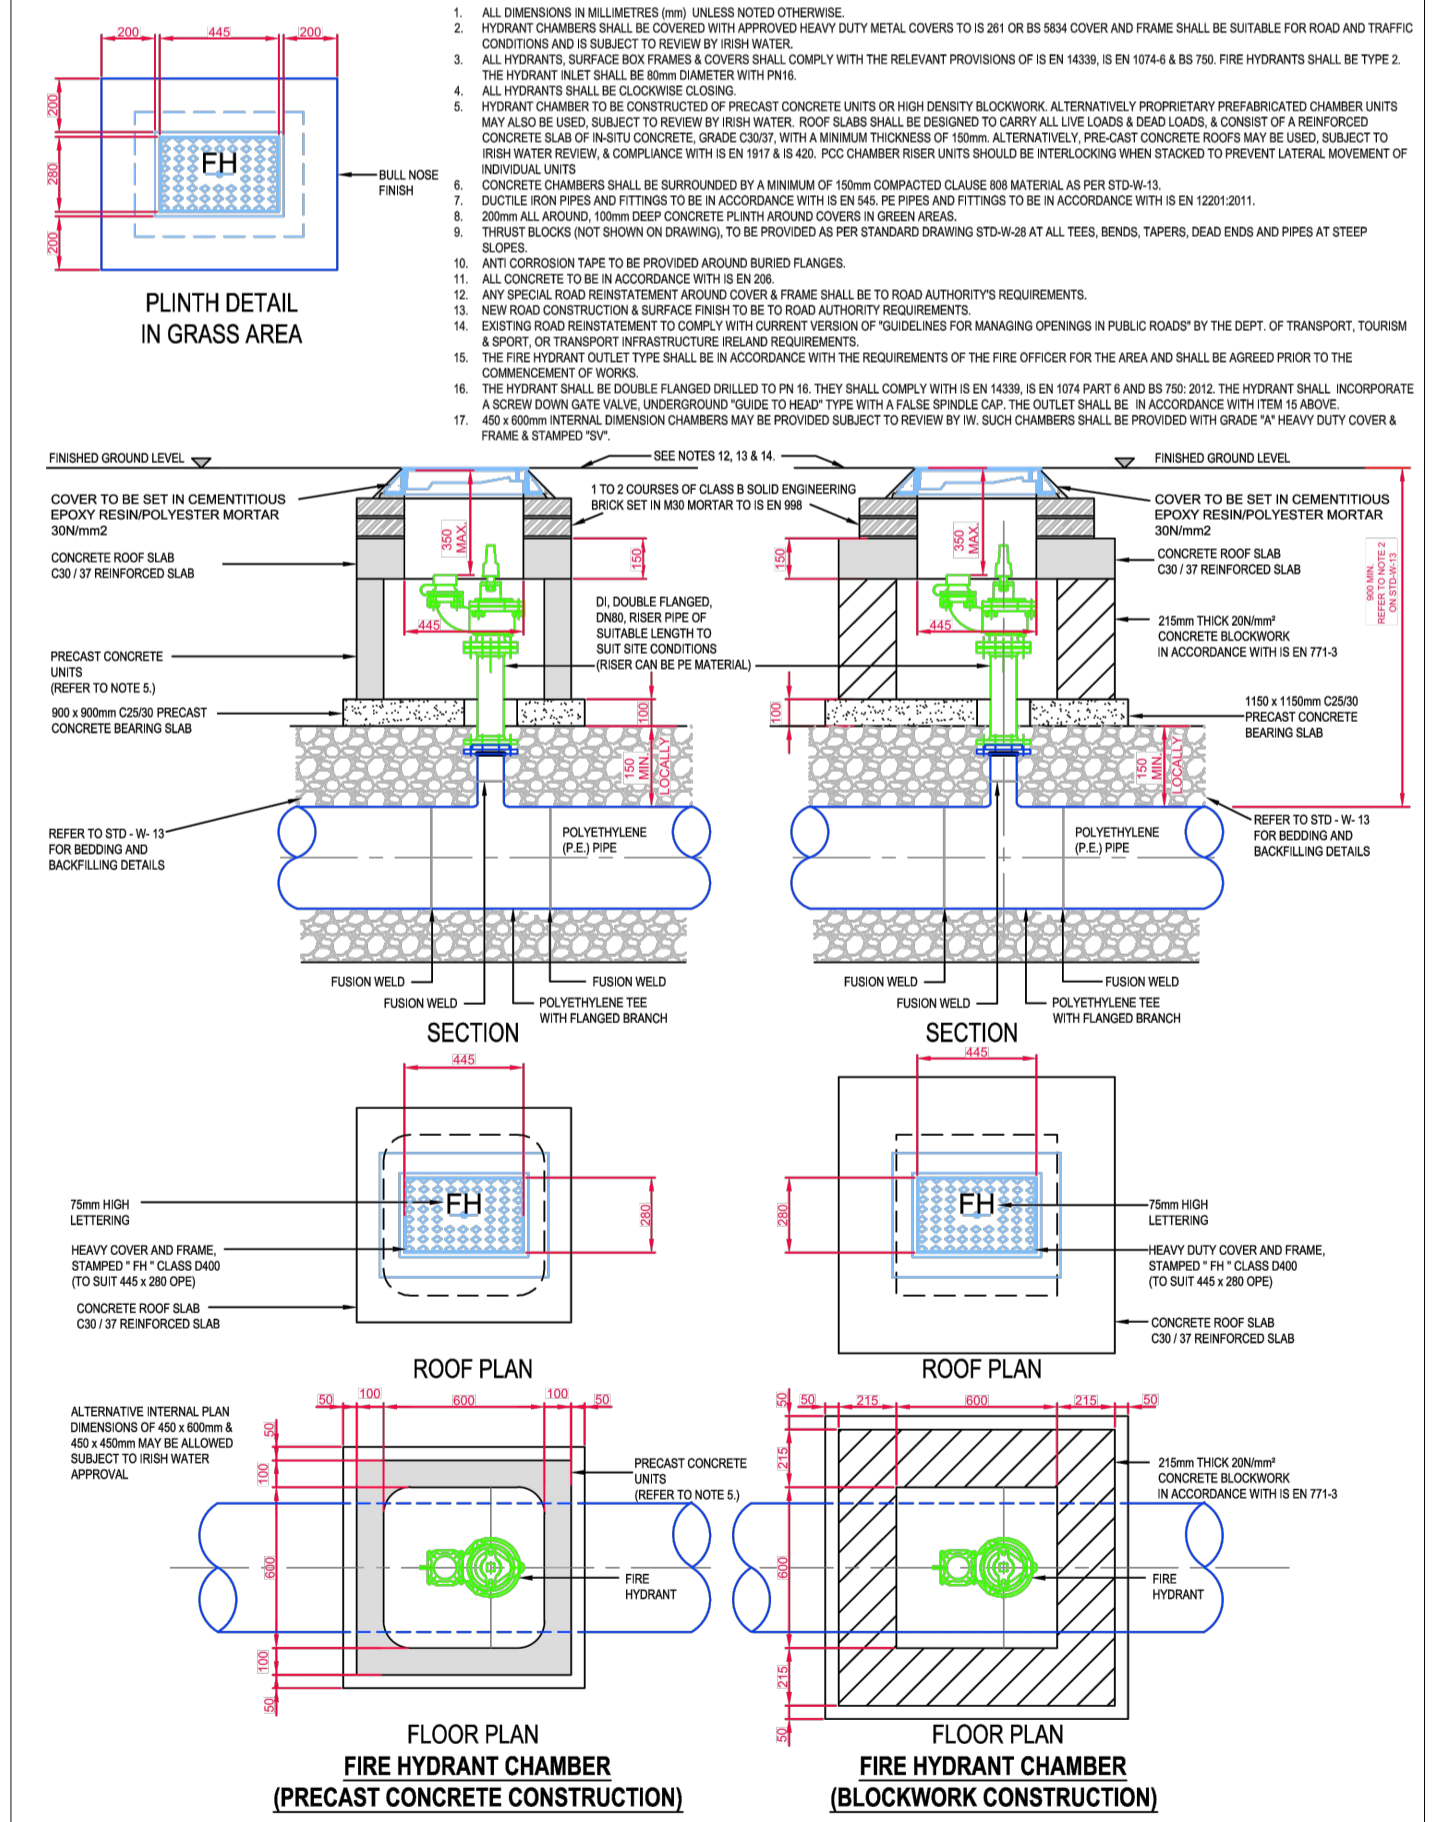


STD-W-18 ON - LINE HYDRANT FOR POLYETHYLENE (P.E.) PIPE - 03_04

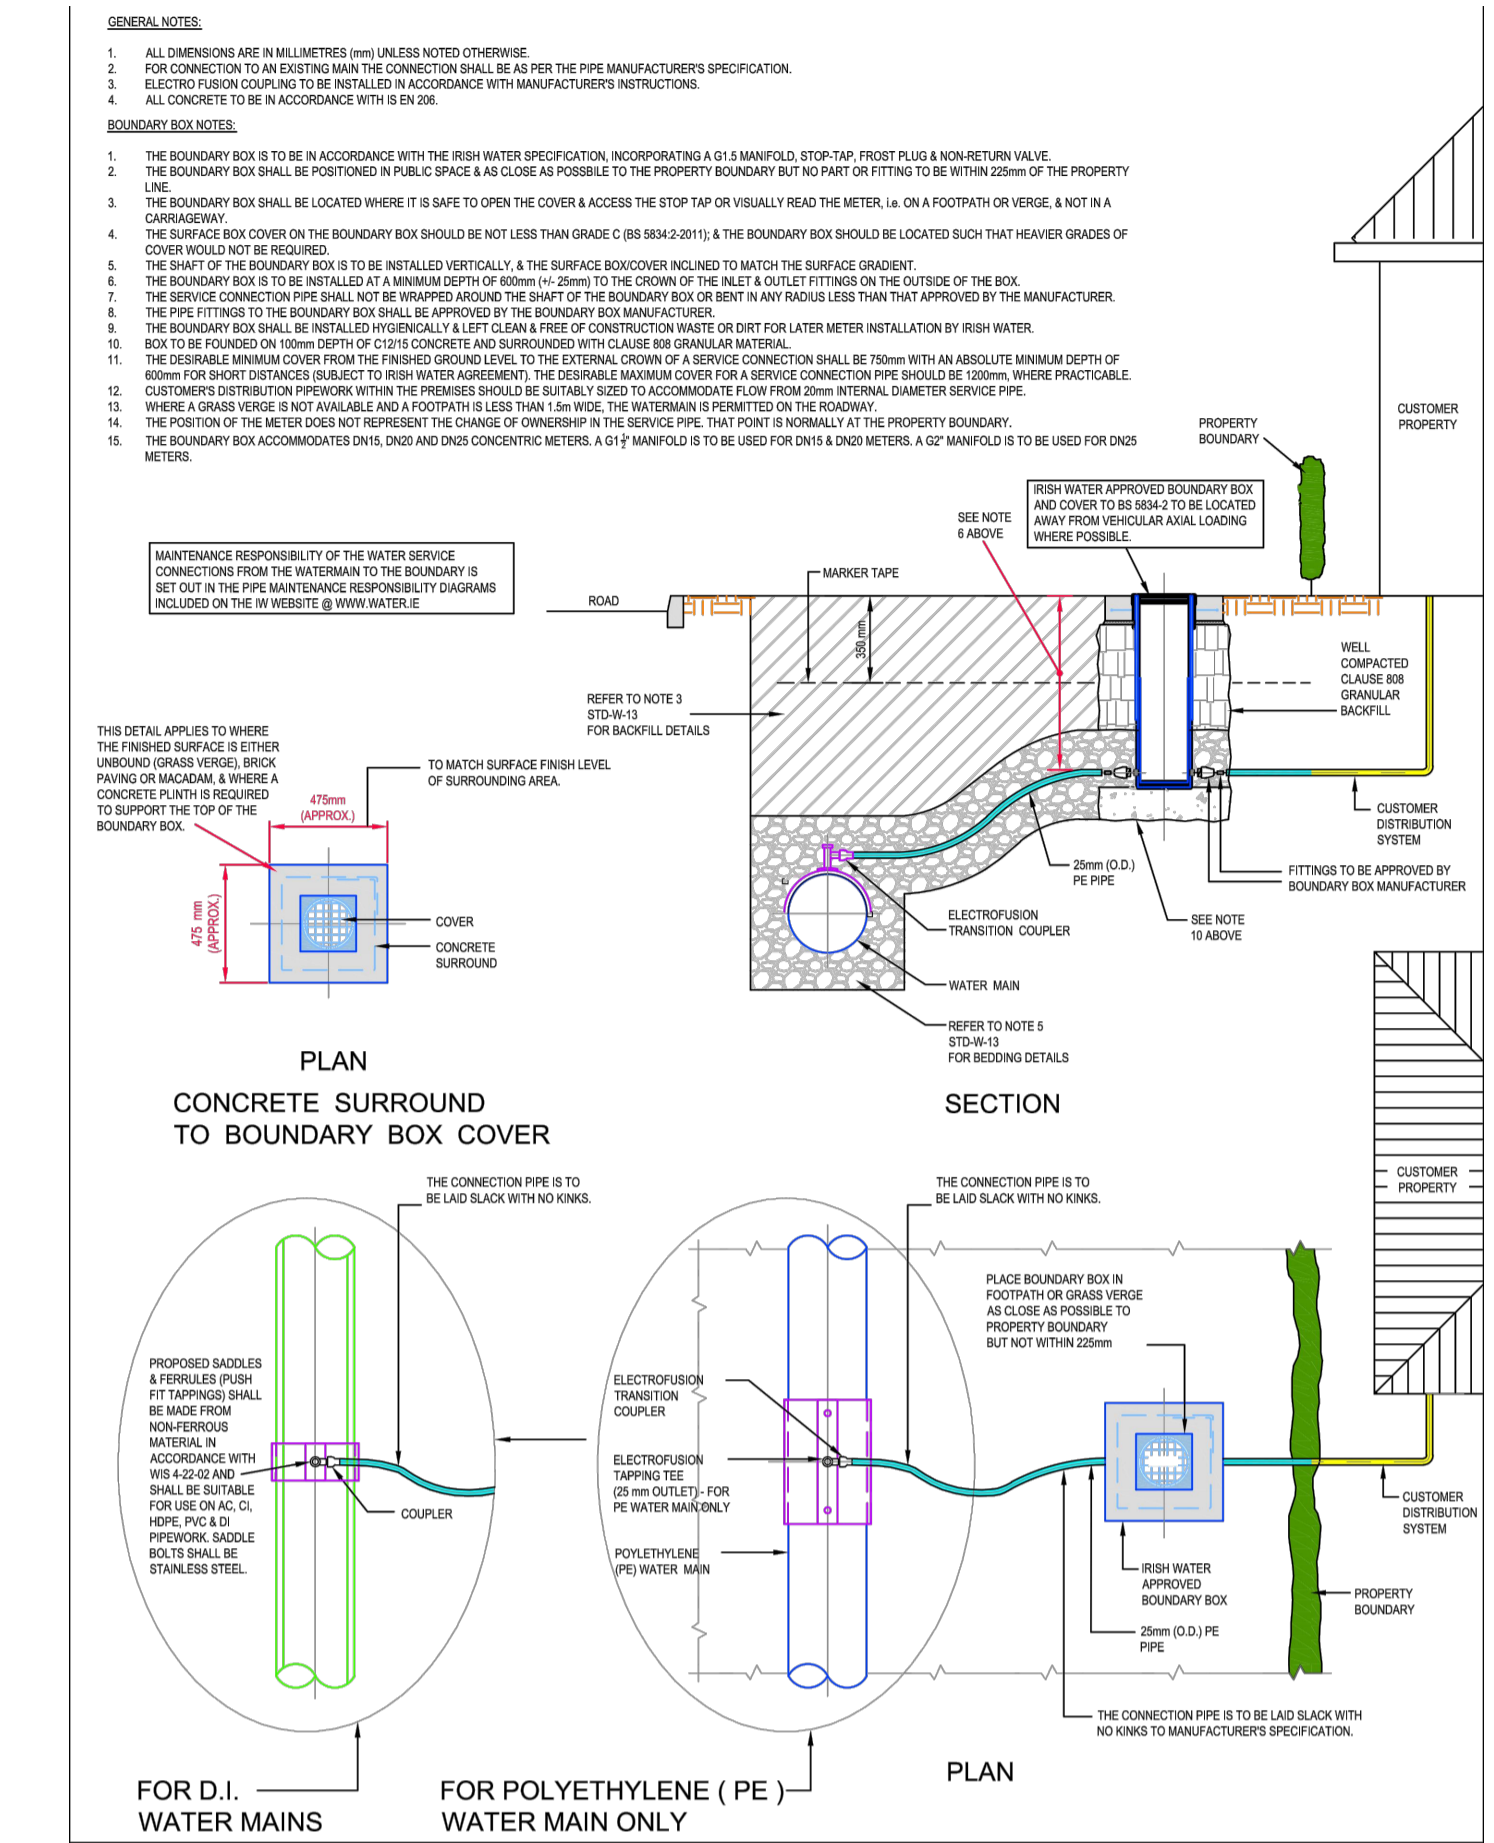


STD-W-03 CUSTOMER CONNECTION AND BOUNDARY BOX (25mm OD PIPE)

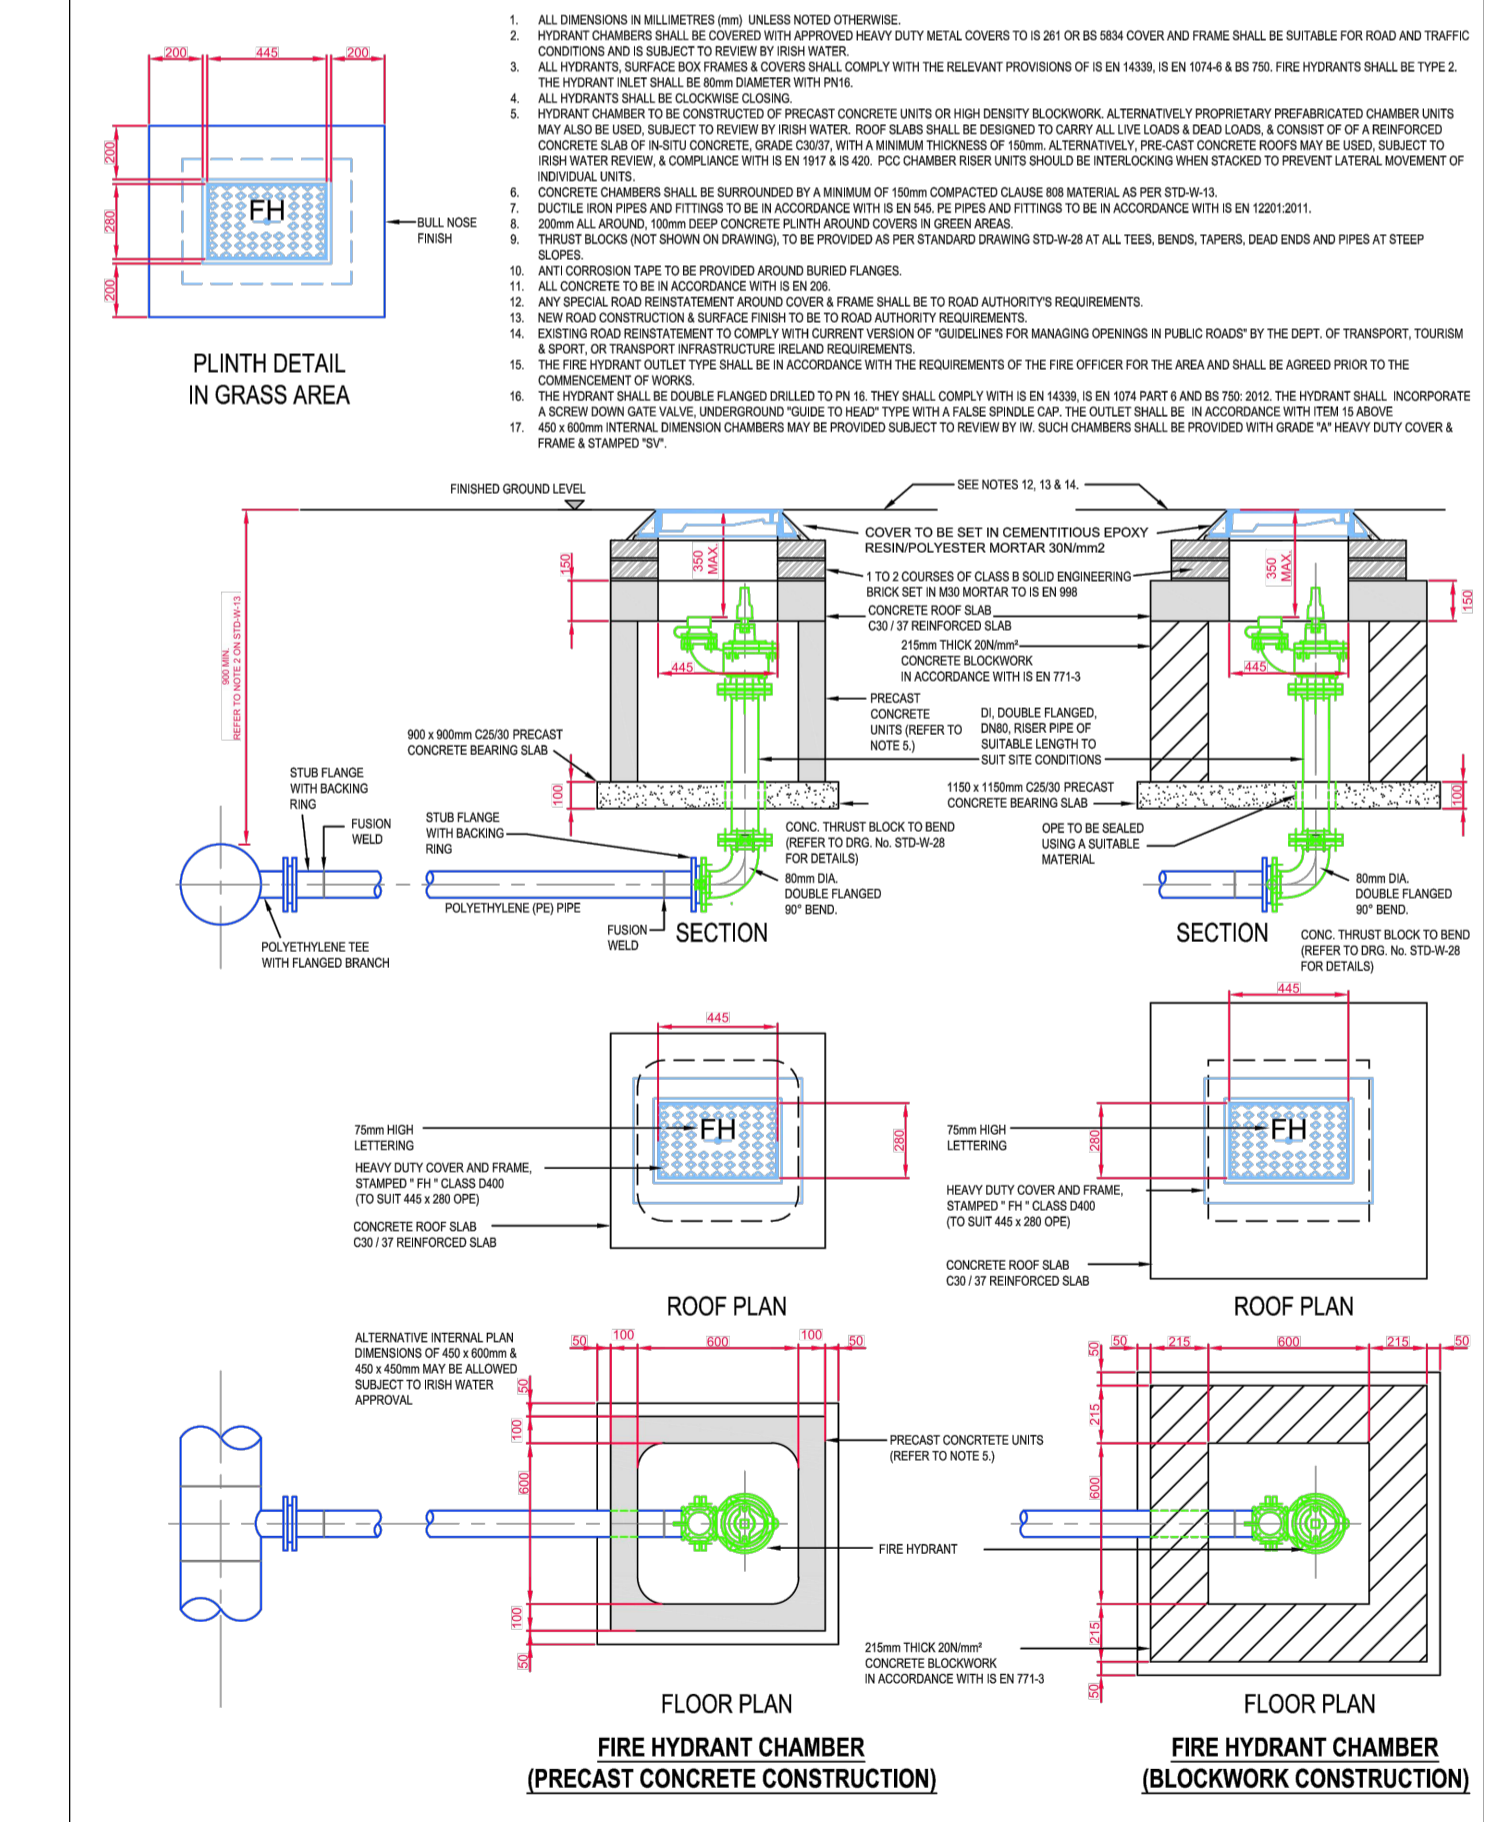


STD-W-19 OFF - LINE HYDRANT FOR POLYETHYLENE (P.E.) PIPE - 04_04

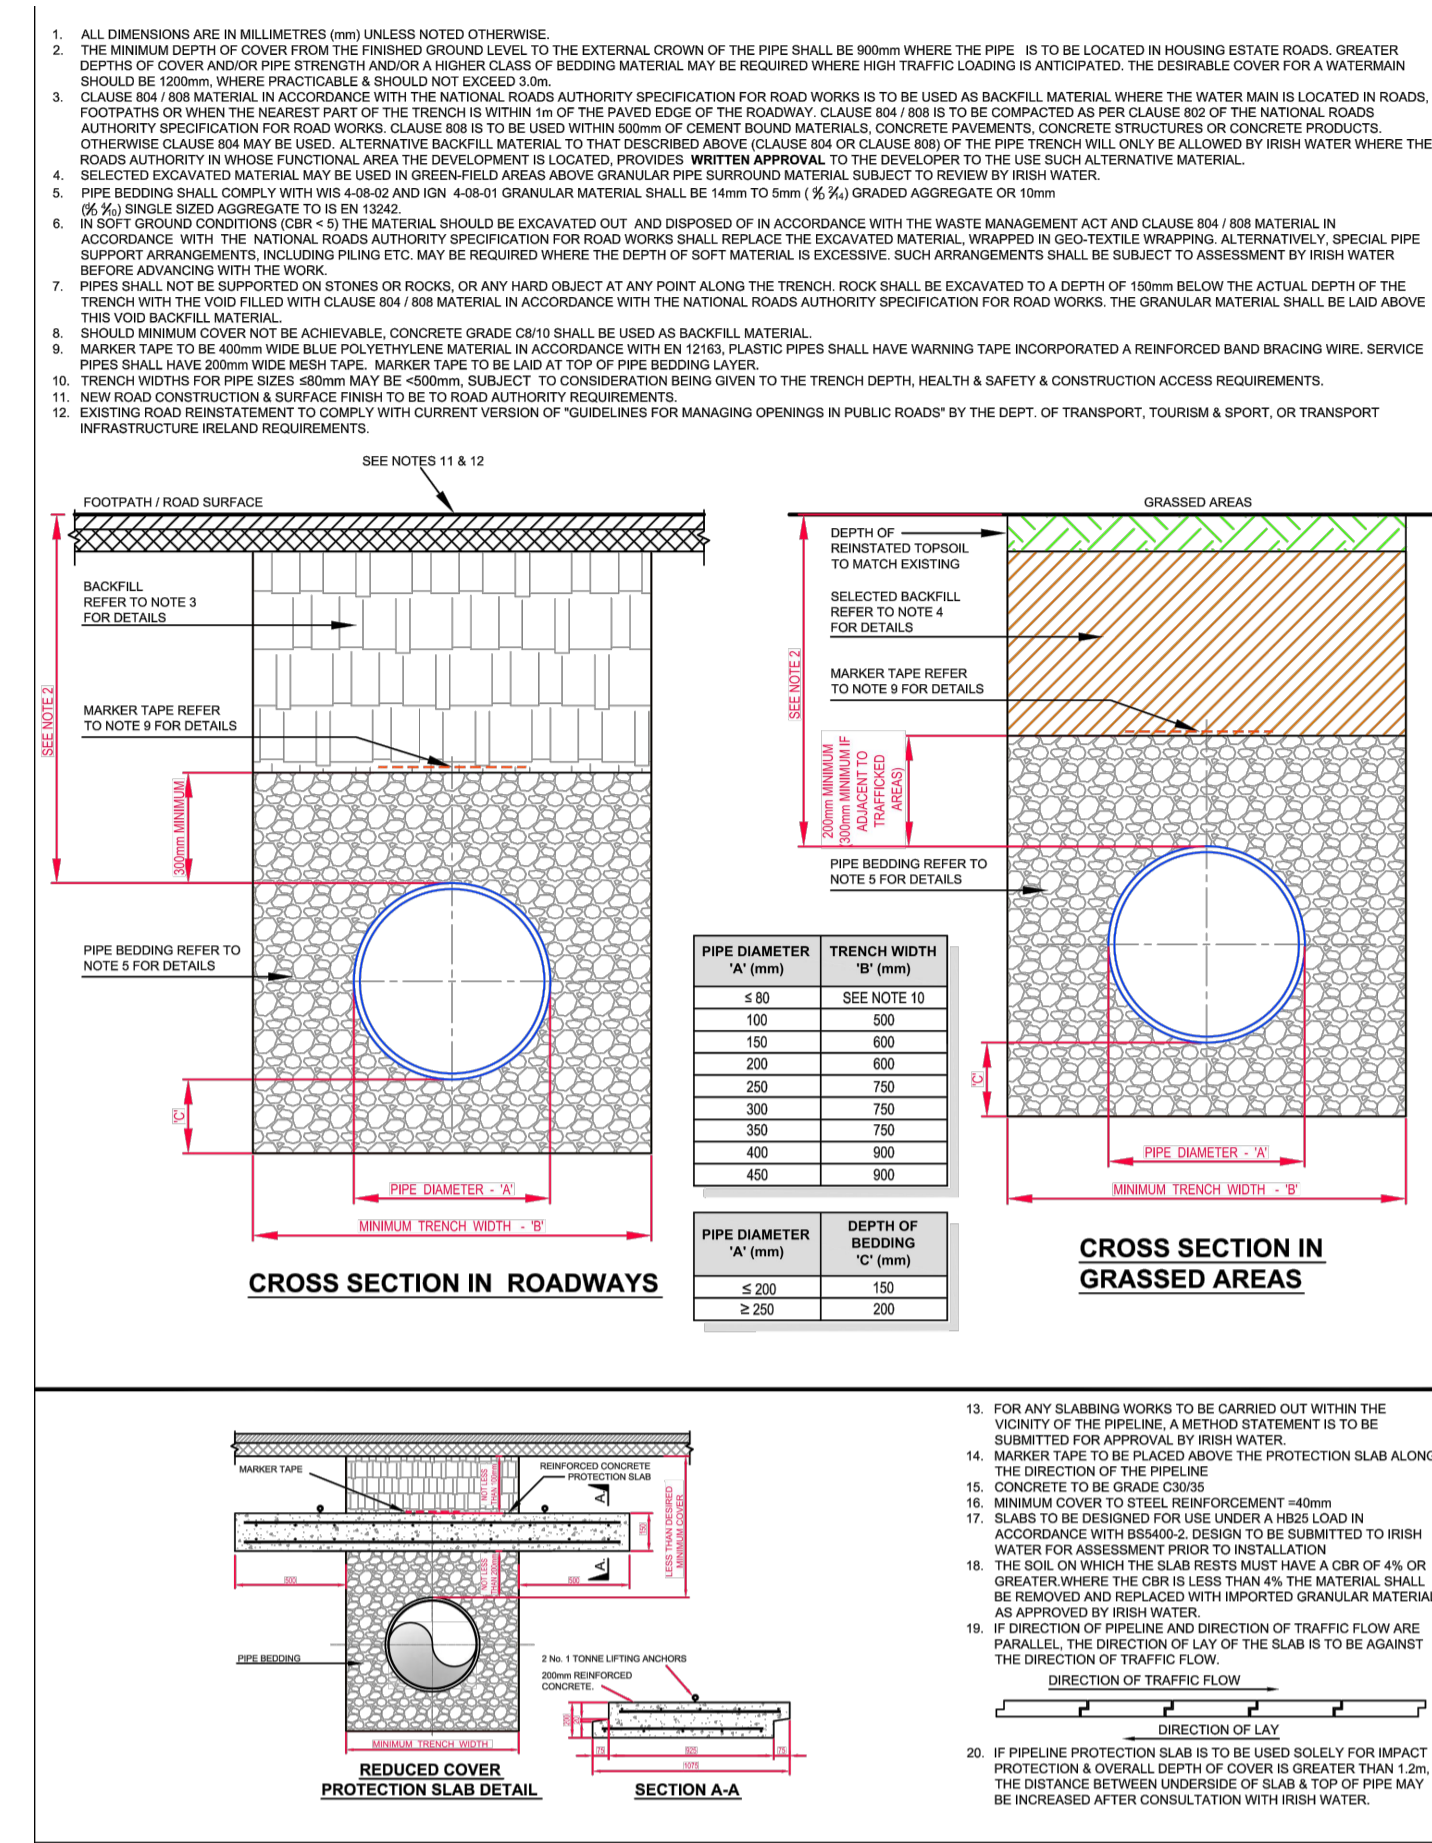

STD-W-13 TRENCH BACKFILL / BEDDING & REDUCED COVER PROTECTION SLAB DETAIL

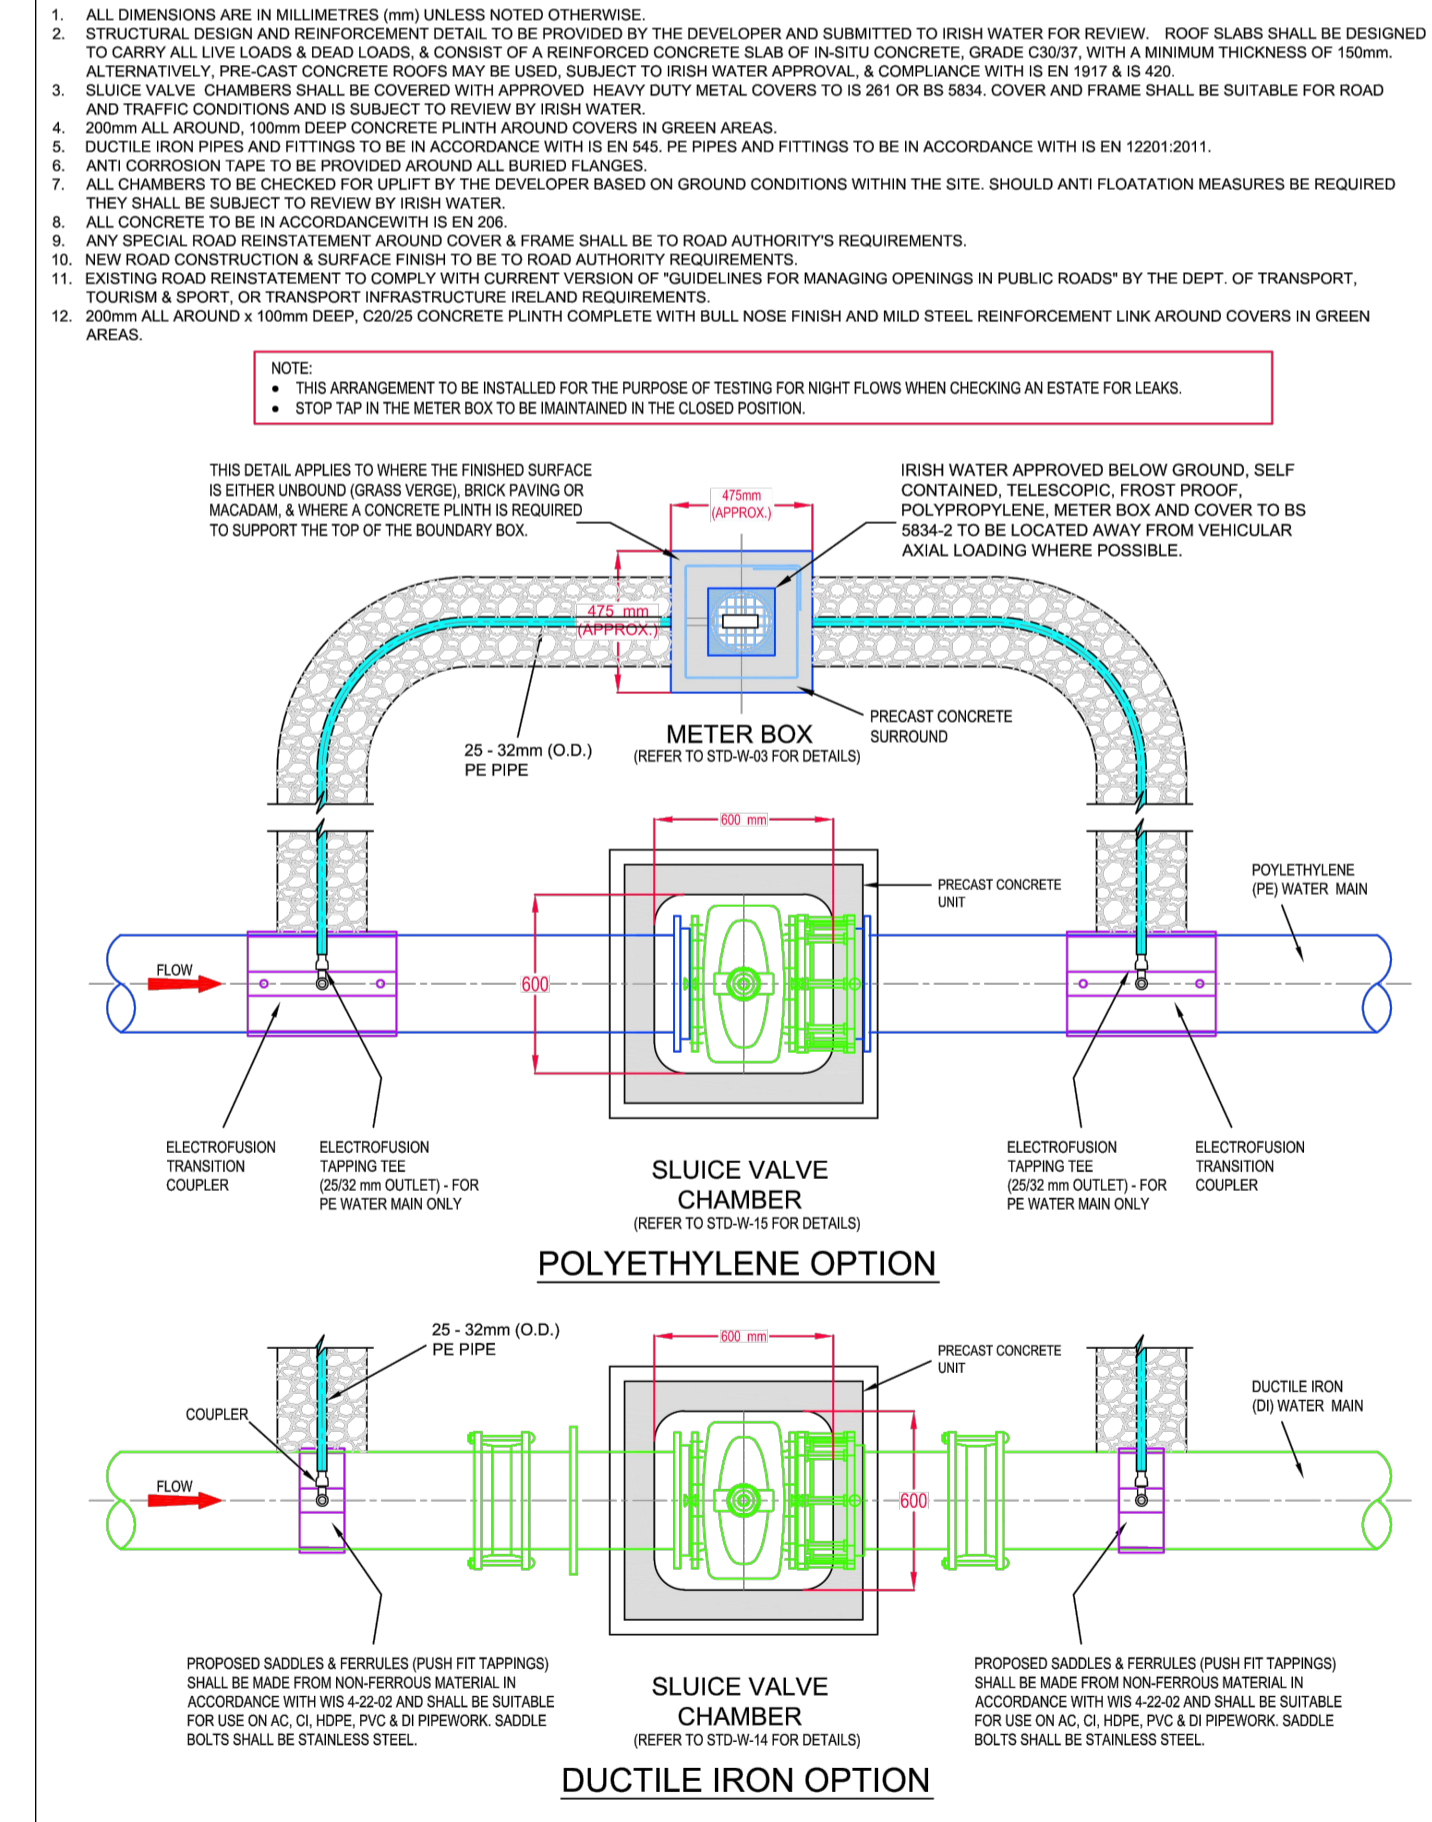

STD-W-26 BY-PASS FLOW METER CHAMBER (25-32mm O.D. DIA.)

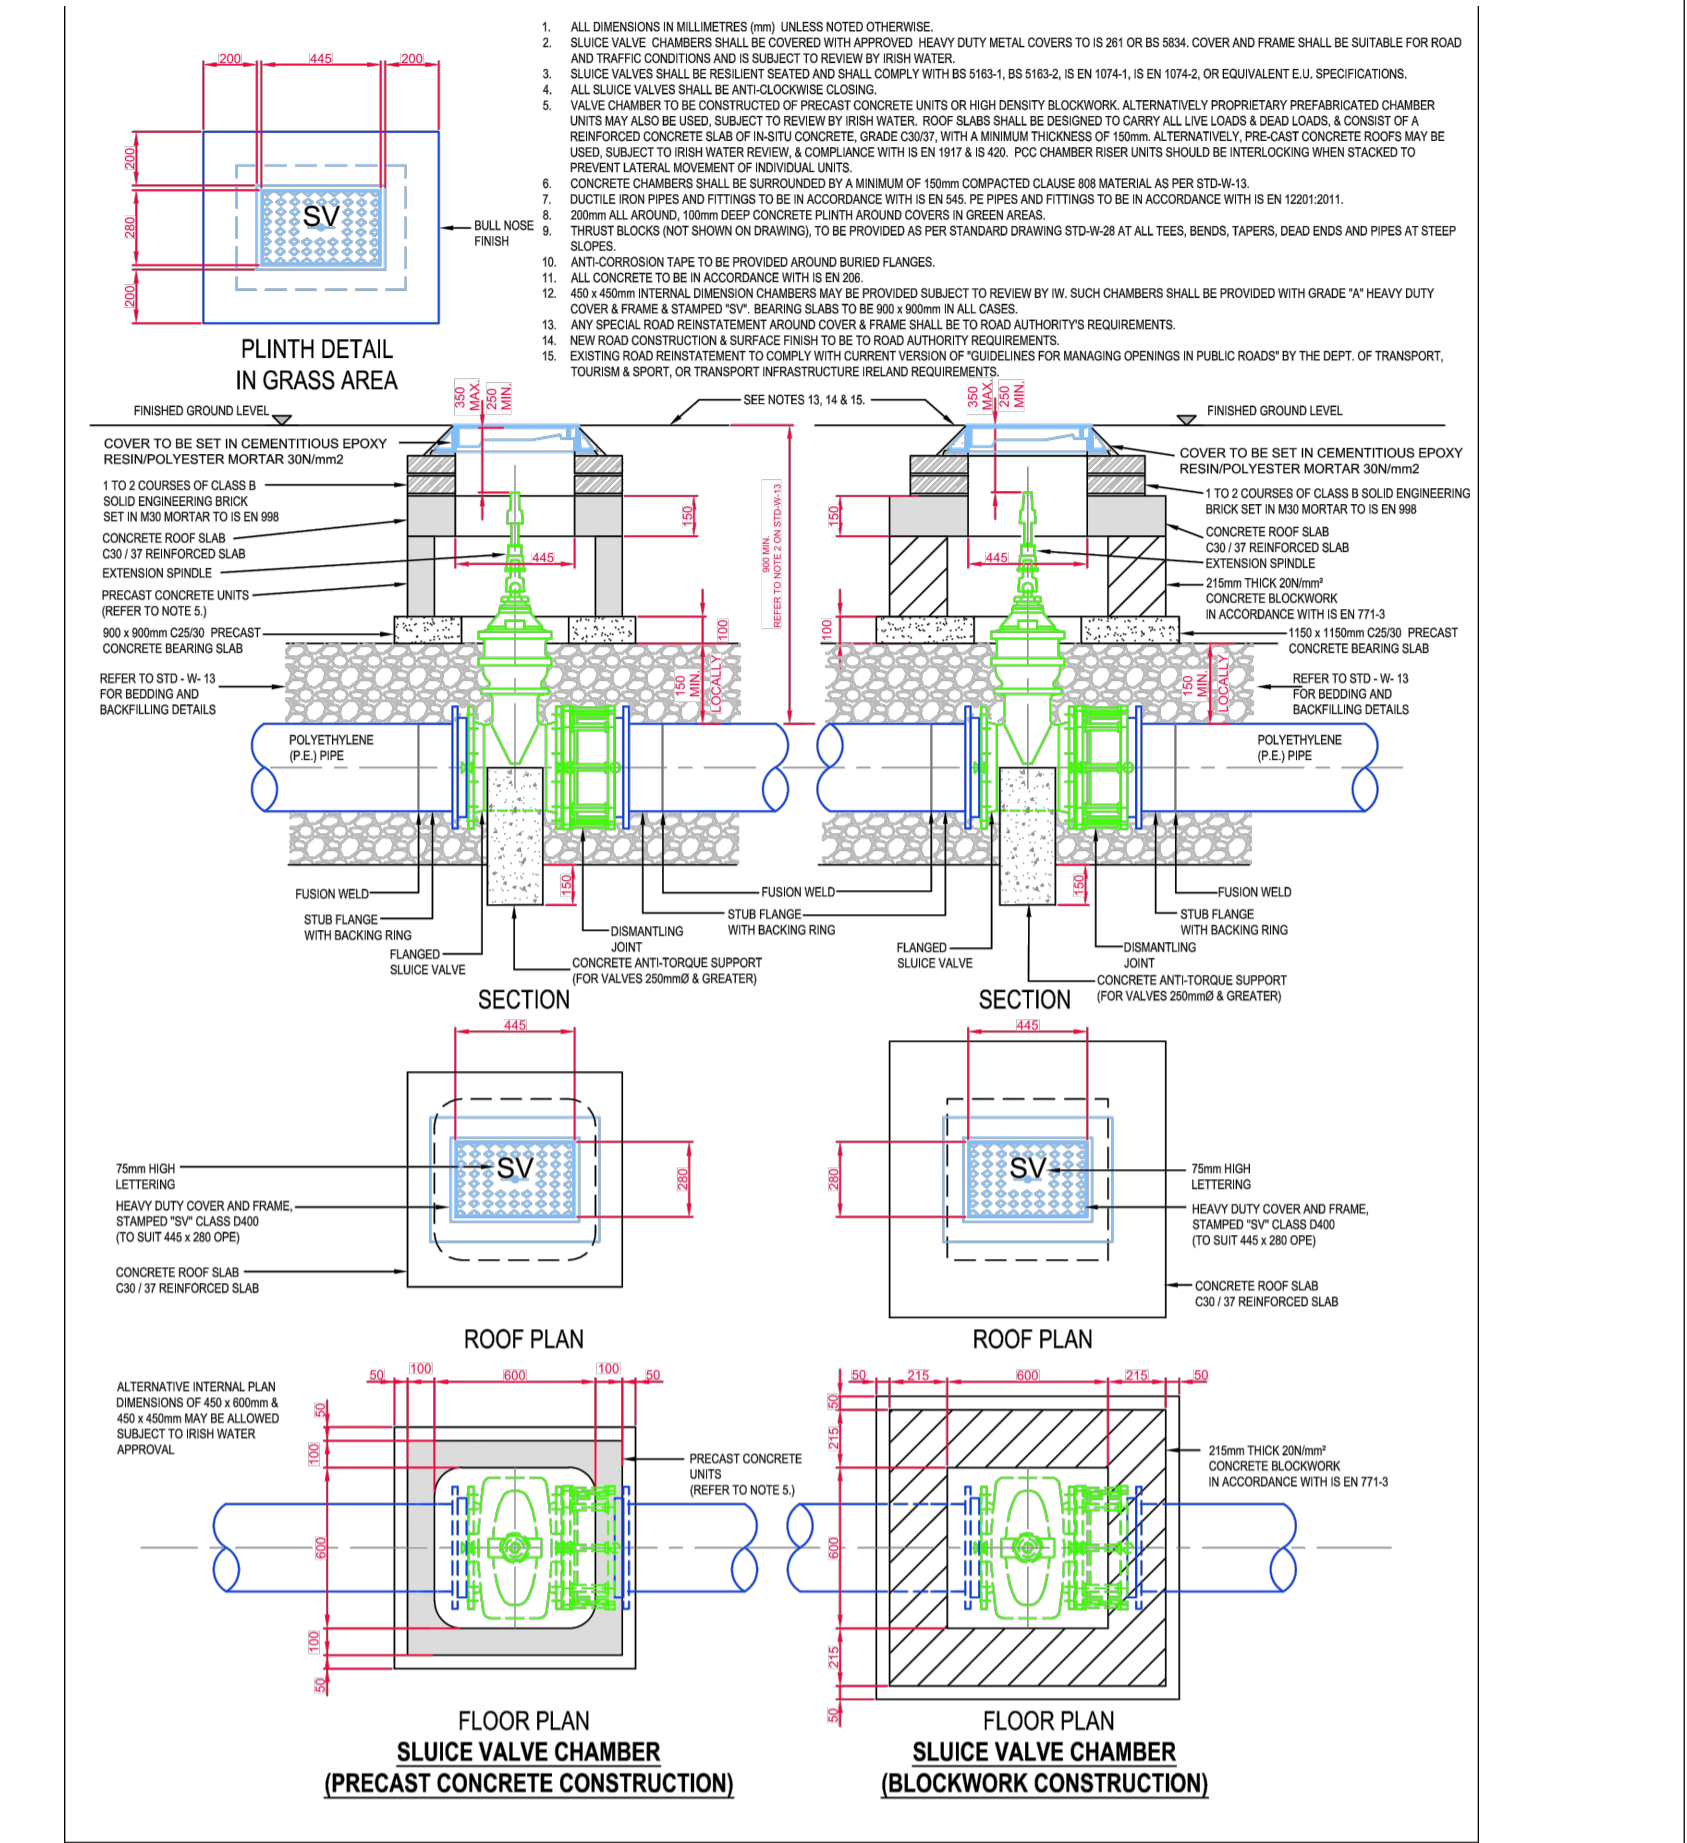

STD-W-15 SLUICE VALVE FOR POLYETHYLENE (P.E.) PIPE ($\le 350\text{mm DIA.}$ - 02_02

NOTES

- For setting out refer to Architect's drawings.
- This drawing to be read in conjunction with all other Architectural and Engineering drawings and all other relevant drawings and Specifications.
- DO NOT SCALE THIS DRAWING. Use figured dimensions only.
- No part of this document may be reproduced or transmitted in any form or stored in any retrieval system of any nature without the written permission as copyright holder except as agreed for use on the project for which the document was originally issued.
- Ordnance Survey Ireland Licence Number EN 0074023

Rev. No.	Date	REVISION NOTE	Dr. By	Chkd. By

LIMERICK COUNTY COUNCIL					
Bruff Residential Development					
Watermain Details					
Dwg. No.	BRUF-CSC-ZZ-XX-DR-C-0007				
Date	Jan 2023	Drn by	SC	Chkd by	FB
Scale	N/A	Aprvd by	N/A	Scale	N/A

Cronin Sutton Cotter
45 O'Connell Street, Limerick, Co. Limerick
T: +353 (0) 61 594988
E: info@cscconsulting.ie
W: www.cscconsulting.ie

Quality Environment Energy Health & Safety

NSAI Certified

IS. EN ISO 9001:2008
IS. EN ISO 14001:2004
IS. EN ISO 50001:2011
OHSAS 18001:2007

DRAFT